MODEL RF

Page 1

STANDARD MATERIALS AND CONSTRUCTION

FRAME:	20-GA galvanized rolled frame, 16" deep.
BLADES:	20-GA double thickness galvanized steel
	(equal to 14-GA).
AXLES:	¹ / ₂ " diameter galvanized or plated steel, full length.
	Oil impregnated bronze sleeve.
STOPS:	Full open and full closed angle stops.
CAULKING:	UL approved.
FINISH:	Mill.
ACTUATOR:	Non-motorized spring closure mechanic with 165°F
	fusible link

OPTIONS

Integral Dual Position Indication (IDPI) switches Rolled retaining angles Stainless steel bearings 212°F fusible link Retaining plates

NOTES

- 1. Dampers are available in 2" diameter increments only.
- 2. Dampers \geq 20" will require factory-mounted rings in the center of the damper.


DAMPER SIZES


		2000 fpm, 4 in. w.g.	3000 fpm, 4 in. w.g.			
	Horizontal & Vertical	Horizontal & Vertical	Horizontal & Vertical			
	Minimum Size	Maximum Size	Maximum Size			
	8" dia.	24" dia.	24" dia.			



This fire damper meets the construction and performance requirements of:

- Underwriters Laboratories Inc. Standard 555
- National Fire Protection Association Standards 80, 90A, 101
- California State Fire Marshal Listing #3225-1328:125
- Underwriters Laboratories Inc. Approved for dual direction airflow and dynamic conditions.
- Underwriters Laboratories Inc. Classified for use in fire resistive ratings of less than 3 hours.

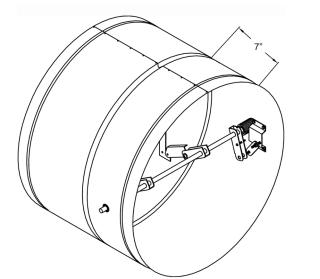

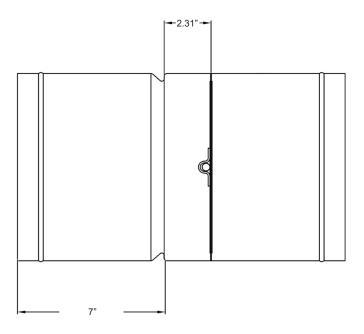

				Vertical	10505	21205		 	
Item #	Otv	Qty Damper Size	Horizontal	Vertical	165°F	212°F			VONAL AS
	2-7		Orien	Orientation Fusible Link		e Link			Union Made
Arch. /	Eng.:				EDR:		ECN:	Job:	
Contractor:									
Project:					Date:		DWN:	DWG:	



MODEL RF

Page 2

True Round Fire Damper A 1¹/₂ Hour Rated **A** Dynamic **A** Galvanized Steel **A** Single Blade

OPERATIONS RATINGS


Maximum Differential Pressure: 4 in. wg Maximum Velocity: 3000 fpm

SOUNDS RATINGS

No ratings available.

PRESSURE DROP RATINGS

The pressure drop data shown below is based on laboratory conditions. The test setup does not take into account elbows or other duct fittings that are part of every actual duct system. The configuration of the actual duct system immediately upstream and downstream of the damper often contributes more pressure loss than the damper itself.

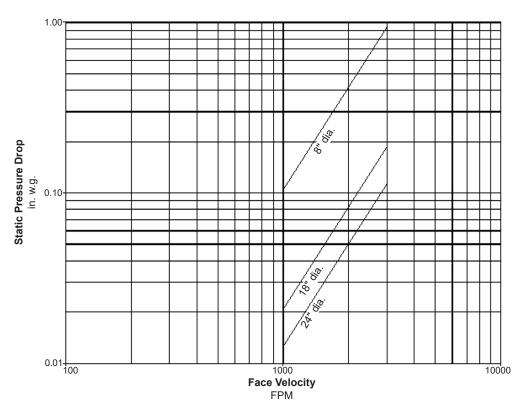

This product was tested in accordance with AMCA Standard 500D.

AMCA Figure 5.3

